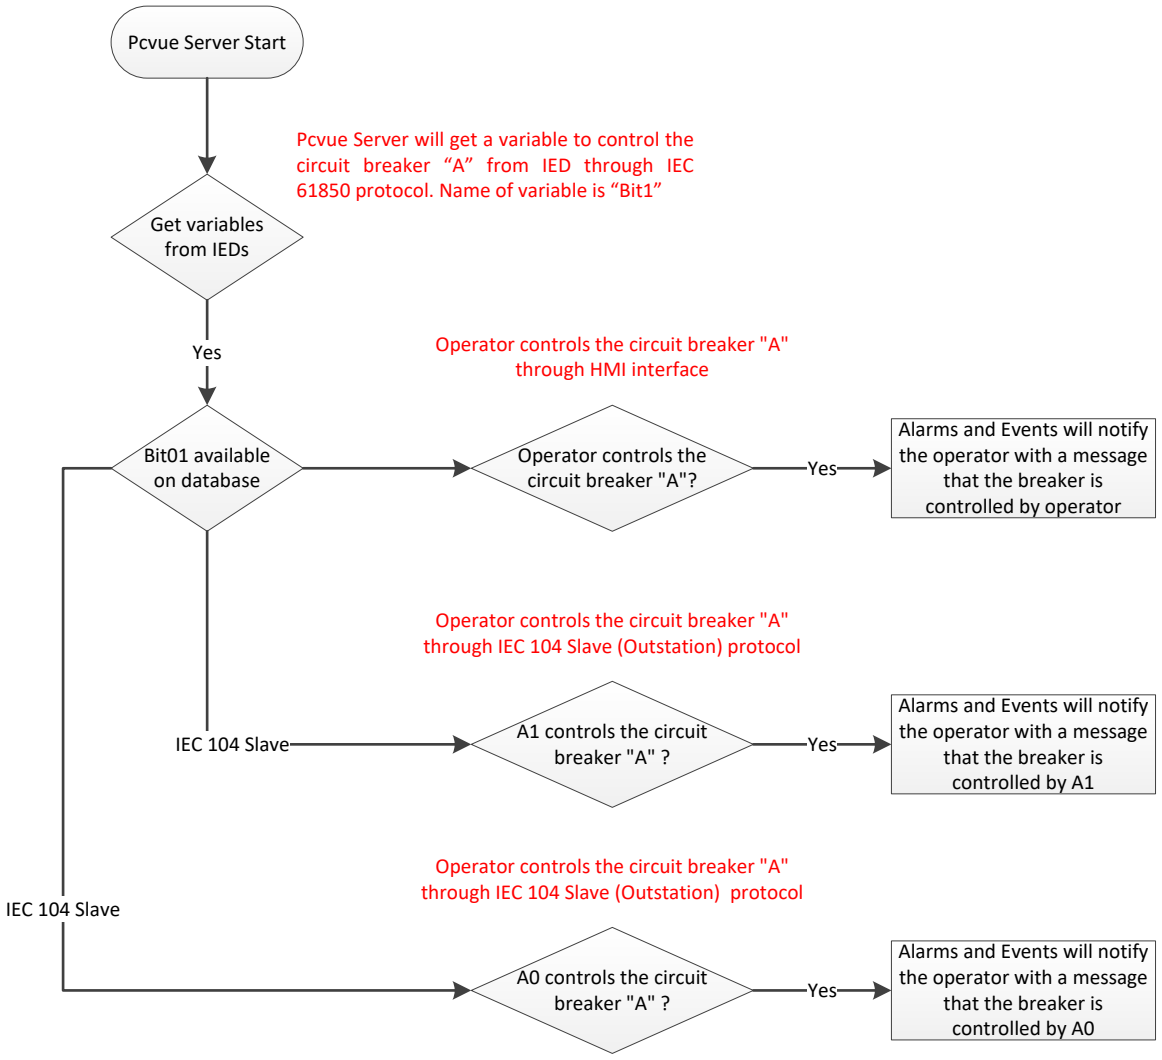
Pcvue Server Start
Pcvue Server will get a variable to control the circuit breaker “A” from IED through IEC 61850 protocol. Name of variable is “Bit1”
Get variables from IEDs
Yes
Operator controls the circuit breaker "A" through HMI interface
Bit01 available on database
Operator controls the circuit breaker "A"?
Yes
Alarms and Events will notify the operator with a message that the breaker is controlled by operator
Operator controls the circuit breaker "A" through IEC 104 Slave (Outstation) protocol
IEC 104 Slave
A1 controls the circuit breaker "A" ?
Yes
Alarms and Events will notify the operator with a message that the breaker is controlled by A1
Operator controls the circuit breaker "A" through IEC 104 Slave (Outstation) protocol
IEC 104 Slave
A0 controls the circuit breaker "A" ?
Yes
Alarms and Events will notify the operator with a message that the breaker is controlled by A0